



**PURCHASING DIVISION  
ROOM 210 CITY HALL  
142 EAST MAIN STREET  
MERIDEN, CONNECTICUT 06450-8022**

**RAWLE DUMMETT  
PURCHASING OFFICER**

**PHONE 203-630-4115**

**NOTICE TO BIDDERS**

**ADDENDUM #002**

**TO THE BID FOR: B025-40 Supply and Install Chiller at Washington Middle School**

**FOR: City of Meriden**

**BID DUE DATE: April 30, 2025 at 11:00 AM**

Please acknowledge receipt of all addenda.

This addenda is to provide answers to the following RFI's:

**Question:** Being that glycol will need to be replaced, is the capacity of the system known?

**Answer:** Contractor will have to determine based on the amount of solution that will to be replaced.

**Question:** Is pre-balancing required for the pumps?

**Answer:** Yes, please refer to Mechanical Demolition Work Note #8 on drawing M0.1

**Question:** Please clarify if only the chilled water piping will be stripped of insulation and re-insulated.

**Answer:** Only the Chilled Water Piping (supply and return) pipe insulation shall be replaced.

**Question:** Please clarify if PVC jacket / colored jacket will be required, if so, would all the piping in the boiler room need colored jacket or only the chilled water piping?

**Answer:** Color coded PVC insulation jacket is not required. PVC jacket shall be applied to all the pipe insulation located up to 8'-0" above finished floor.

**Question:** Please clarify the seismic section on the specifications, would it be required for the chiller/pump.


**Answer:** Seismic protection is not required. Specifications Section 23 05 48 may be omitted.

**Question:** For the requested (1) additional drum of glycol, would it need to be 100% or 20% of propylene concentration.

**Answer:** Contractor shall provide 20% propylene solution

**Question:** Please provide manufacturer/information on existing panel HBRP for providing new 70A breaker.

**Answer:** Existing panel HBRP: Square-D, I-Line Panelboard, 480Y/277V-3Ø-4W, 400A, Catalog #44-81415-06. Contractor shall field verify information.

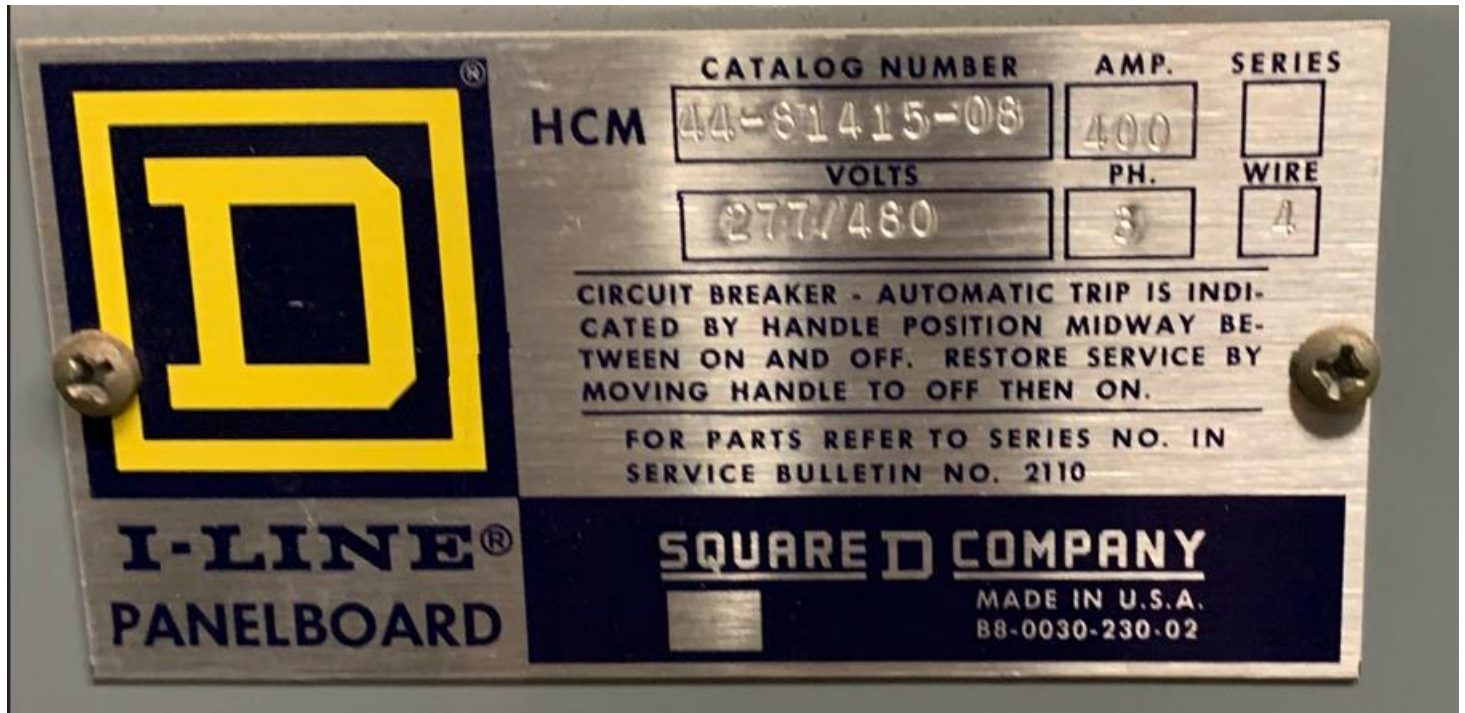

Rawle Dummett  
Purchasing Officer  
Dated: April 25, 2025